

Investigating on the Possible Radial Structures of a Real Medium Voltage Distribution System

HORIA ANDREI

Valahia University of Targoviste, Faculty of Electrical Engineering
18-20 Blv. Unirii, Targoviste, Dambovita
ROMANIA

GIANFRANCO CHICCO

Politecnico di Torino, Dipartimento di Ingegneria Elettrica
corso Duca degli Abruzzi 24, 10129 Torino
ITALY

NICOLAE COROIU

Electrica SA, Grigore Alexandrescu street no.9, Sector 1, Bucharest
ROMANIA

MIRCEA POPA

S.C. Electrica S.A. North Transilvania - SDFEE Oradea
ROMANIA

MARIUS SILAGHI

University of Oradea, Electrical Engineering Faculty
Armata Poporului street no.5, Oradea,
ROMANIA

Abstract:- This paper addresses the creation of a reduced weakly meshed network containing the basic information for applying suitable numerical techniques for solving specific issues related to the distribution system reconfiguration for large real Medium Voltage distribution systems. In particular, the structure of the network and the installed components (connections to the High Voltage supply system, network branches and location of the loads) are taken into account to form a layered structure that can be used as starting configuration for calculating the number of possible radial configurations and for applying deterministic or heuristic methods for estimating the pseudo-optimal radial system configuration according to a specified objective function. The results are shown on the real case of the Medium Voltage distribution system of the city of Oradea.

Key-words:- distribution system, layered structure, medium voltage, radial configurations, redundant branches, substations.

1 Introduction

Medium Voltage (MV) distribution systems are typically supplied from the nodes of the High Voltage (HV) transmission system or from the nodes of distribution systems at different (normally higher) voltage levels through the connection transformers. The MV loads are served through a number of branches (overhead lines or underground cables). The MV network by construction has a weakly meshed structure, but its operation is carried out by opening a number of redundant branches so as to create a radial structure, in order to simplify the protection schemes. Various rationales may be used for

selecting the strategy for opening the redundant branches. The distribution system operators tend to define a base configuration, used for carrying out the general technical evaluations adopted as references for the distribution system operation, also used to provide reference data to the electricity Authority.

In general, it is possible to search for the optimal distribution system configuration according to a specified objective function (e.g., based on the distribution system losses, or formulated in economic terms). Deterministic or heuristic methods can be used

for this purpose [1-3]. Given the original weakly meshed network, the solution methods need to explore the various configurations. However, the presence of non-symmetries in the system layout makes it very difficult even to enumerate the possible radial configurations that can be extracted from the original structure. Classical graph theory approaches [4] may be used for this purpose, but for weakly meshed networks it is possible to simplify the calculations by adopting more specific search techniques [5-18].

For a real distribution system, several practical aspects have to be taken into account in building the network configurations, including the location of the supply substations, the presence of different busbar schemes, the structure of the feeders and the possible identification of independent areas. This paper presents and discusses some criteria for simplifying the initial weakly meshed network structure, in order to build a reduced network, again with weakly meshed structure, to be used for determining the possible radial structures before running suitable distribution system reconfiguration algorithms. A dedicated application case built on the Medium Voltage distribution system of the city of Oradea is discussed in detail.

2 Construction of the Reduced Network

Starting from the initial structure of the MV distribution system, the reduced network is created, in order to assist the evaluation of the possible radial configurations of the network, according to the following set of principles, derived both from theoretical reasoning and from practical considerations:

1. the HV transmission system constitutes the backbone of the system and is considered to be always available; the possible supply coming from other MV systems are considered to be always available as well; all the supply nodes are then merged into a unique supply node, here called *root node*;
2. no load node has to be isolated;
3. possible branches directly connecting two supply points are eliminated from the reduced network, considering them as open branches in the normal operation under study;
4. possible branches connecting two supply points, in which there are one or more loads in series, are considered separately with respect to the reduced network under construction, since their contribution to the total number of possible radial configurations (equal to the number of branches in series along the path) can be determined independently of the rest of the network;
5. possible branches connecting one or more nodes *in antenna*, that is, with no other return path, are eliminated from the reduced network, since these branches have to be always closed in the normal operation under study,

for maintaining all the nodes connected to the distribution system;

6. the branches connecting a number of nodes in series are replaced by a single branch, storing the information on the number of branches in series as a multiplicity factor; in fact, only one branch at a time has to be open along the series path without isolating one or more of the intermediate nodes along the series path;

7. possible parallel paths among two nodes are replaced with a single equivalent branch, again storing the information on the number of parallel connections.

3 Application to a Real Distribution System

The 6-kV distribution system of the city of Oradea is considered. The system is supplied by five HV/MV substations with 110 kV to 6 kV transformation (i.e., Crisul, Iosia, Oradea Centru, Sinteza and Velenta) and by other four connections to the 20-kV distribution system with 20 kV to 6 kV transformations, for a total of $S = 9$ supply points. The complete structure of the network is not shown here for lack of space.

The reduced network has by definition a single supply point ($S_R = 1$). Applying the principles indicated in the above section, the resulting reduced network has $B = 101$ branches and $N = 57$ nodes (supply point included). The rhomboidal marks along the branches represent the loads connected along the feeder, that determine the branch multiplicity. The structure used to form the reduced network is shown in Fig. 1. The supply points forming the root node are labelled as node 1 in the scheme. The dashed branches represent situations of branches connecting one or more nodes to a supply point, or branches connecting two supply points that can be considered independently in the evaluation of the number of radial configurations. In order to create any radial configuration, it is then necessary to open simultaneously $Q = B - N + S_R = 45$ redundant branches. Providing the list of the open branches is a sufficient information for representing a radial configuration. With respect to the network in Fig. 1, the reduced network does not contain the dashed branches, and the supply nodes coalesce into the root node (i.e., node 1). According to the principles followed for the construction of the reduced network, the number of redundant branches is the same as the one required for obtaining a radial structure from the original network [5].

4 Layered Structure of the Reduced Network

The reduced network can be redrawn in such a way to form a layered structure, with the first layer formed by

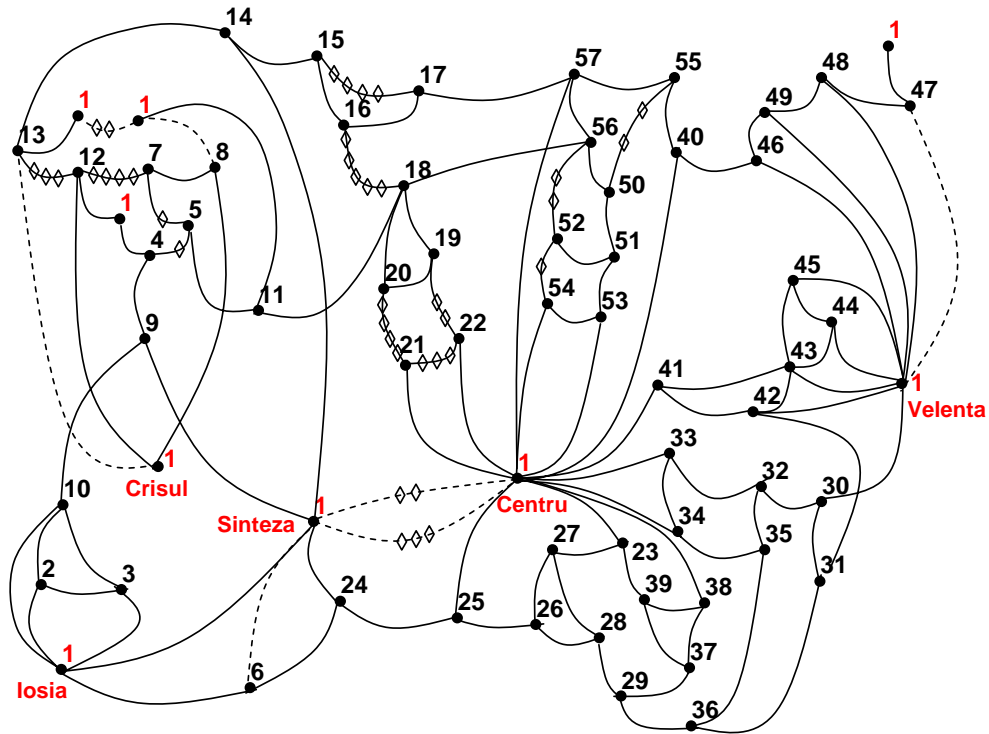


Fig. 1: Reduced Oradea 6-kV network.

Table I: Nodes belonging to the various layers (node 1 = root node)

layer	nodes
1	1, 6, 8, 9, 11, 12, 13, 14, 21, 22, 23, 24, 25, 30, 33, 34, 38, 40, 41, 42, 43, 44, 45, 46, 47, 49, 53, 54, 57
2	5, 7, 10, 15, 17, 18, 19, 20, 26, 27, 31, 32, 35, 37, 39, 51, 52, 55, 56
3	16, 28, 29, 36, 50

Table II: Connections of the nodes of the reduced network at the third layer to nodes at the second or third layer and related multiplicities. N3 = node of the third layer; NL = connected node; m = branch multiplicity

N3	NL	m	N3	NL	m	N3	NL	m	N3	NL	m	N3	NL	m
16	15	1	28	26	1	29	28	1	36	29	1	50	51	1
	17	1		27	1		30	1		31	1		55	3
	18	6		29	1		37	1		56	1			

all the nodes of the reduced network connected to the root node, the second layer is formed by all the nodes of the reduced network connected to nodes of the first layer, and so forth.

Table I shows the nodes belonging to the various layers. In spite of the relatively large number of nodes and of the weakly meshed structure of the reduced network, the maximum number of layers that can be identified is *three*, and the nodes belonging to the third layer are only *five* (the nodes number 16, 28, 29, 36

and 50).

Table II shows the connections from nodes belonging to the third layer to the nodes of the second layer, with the related multiplicities m .

The interest towards constructing the layered structure of the network is due to the possibility of selecting a number of branches to open for creating the radial system mainly from the layers with the higher order (e.g., 2 and 3, in the case considered). The rationale of this choice is that structurally long feeders

are more likely to produce higher losses in the branches connected to the supply points. This is true especially if the system loads are distributed uniformly, but in general reductions of the network obtainable for instance by merging the nodes of the first layer into the root node can be used to simplify the space of search of the radial configurations that minimize the system losses.

5 CONCLUSIONS

The creation of the reduced network and of the corresponding layers is a viable starting point for simplifying the application of the solution methods for optimal distribution system reconfiguration.

The real-case example presented in this paper has shown that it is possible to obtain significant reductions in the network structure by applying the criteria indicated, and that the reorganization of the reduced network results into a relatively low number of layers.

These results can be associated to the knowledge of the power flow solutions in order to establish sound criteria for selecting the best radial configuration according to a specified objective function.

References

- [1] H.-D. Chiang, and R. Jean-Jumeau, Optimal network reconfiguration in distribution systems, Part I: Solution algorithms and numerical results, *IEEE Trans. on Power Delivery*, Vol.5, No.3, 1990, pp.1568-1574.
- [2] R.J. Sarfi, M.M.A. Salama, and A.Y. Chikhani, A survey of the state of the art in distribution system reconfiguration for system loss reduction, *Electric Power Systems Research*, Vol.31, 1994, pp. 61-70.
- [3] M.E. Baran and F.F. Wu, Network reconfiguration in distribution systems for loss reduction and load balancing, *IEEE Trans. on Power Delivery*, Vol.4, 1989, pp.1401-1407.
- [4] W. Mayeda, *Graph Theory*, John Wiley and Sons, New York, 1972.
- [5] H. Andrei, I. Caciula, and G. Chicco, An efficient algorithm for forming radial structures from weakly meshed networks, *Proc. VI World Energy System Conference*, Torino, Italy, July 10-12, 2006, pp. 175 -180.
- [6] M. E. Baran, and F. F. Wu, Network Reconfiguration in distribution systems for loss reduction and load balancing, *IEEE Trans. on Power Delivery*, **4**, 1989, pp. 1401-1407.
- [7] A. Augugliaro, L. Dusonchet, E. Riva Sanseverino, Genetic, Simulated Annealing and Tabu Search Algorithms: Three Heuristic Methods for Optimal Reconfiguration and Compensation of Distribution Networks, *European Trans. on Electric Power* **9**, 1, pp.1999, 35-41.
- [8] E. Carpaneto, G. Chicco, and E. Roggero, Comparing deterministic and simulated annealing - based algorithms for minimum losses reconfiguration of large distribution systems, *Proc. IEEE Porto Power Tech 2001*, Porto, Portugal, Sept. 10-13, 2001, paper PST3-237.
- [9] H - C Chang, and C - C. Kuo, Network reconfiguration in distribution systems using simulated annealing, *Electric Power Systems Research* **29**, 1994, pp. 227-238.
- [10] R. Cherkaoui, A. Bart, and A.J. Germond, Optimal configuration of electrical Distribution networks using heuristic methods, *Proc. 11th PSCC*, Avignon, France, Aug. 1993 pp. 147-154.
- [11] Y - J Jeon, J - C Kim, J-O Kim, J-R Shin, and K. Y. Lee, An efficient Simulated Annealing Algorithm for Network Reconfiguration in Large-Scale Distribution Systems, *IEEE Trans. on Power Delivery* **17**, 4, October 2002, pp.1070-1078.
- [12] H. Mori, and Y. Ogita, A Parallel Tabu Search Based Method for Reconfigurations of Distribution Systems, *Proc. IEEE/PES Summer Meeting, Seattle*, WA, July 2000, **1**, pp. 73-78.
- [13] K. Nara, A. Shiose, M. Kitagawa, and T. Ishihara, Implementation of genetic algorithm for distribution systems loss minimum reconfiguration, *IEEE Trans. on Power Systems* **7**, 3 August 1992, pp. 1044-1051.
- [14] V. Parada, J. A. Ferland, M. Arias, and K. Daniels, Optimization of electrical distribution feeders using simulated annealing, *IEEE Trans. on Power Delivery* **19**, 3 July 2004, pp. 1135-1141.
- [15] G. Peponis, and M. Papadopoulos, Reconfiguration of radial distribution networks: application of heuristic methods on large-scale networks, *IEE Proc. Gen. Trans. Distr.* **142**, 6 November 1995, pp. 631-638.
- [16] H. Andrei, G. Chicco, C. Cepisca and, I. Caciula, Determination of Radial Structures from Meshed Networks with a Backtracking - based Procedure, *WSEAS Trans. on Circuits and Systems*, Vol.5, No.11, November 2006, pp. 1614-1619.
- [17] C.R. Reeves, *Modern heuristic techniques for combinatorial problems* (ISBN 0-470-22079-1), Blackwell Scientific Publ, Oxford, UK 1993.
- [18] R.J. Sarfi, M.M.A. Salama, and A.Y. Chikhani, A survey of the state of the art in distribution system reconfiguration for system loss reduction, *Electric Power Systems Research* **31**, 1994, pp. 61-70.